


City of Loveland Water Treatment Plant Effluent PFAS Results

Since 2020

* City of Loveland WTP is NON-DETECT FOR PFOA, GenX, PFBS, PFHxS, & PFNA

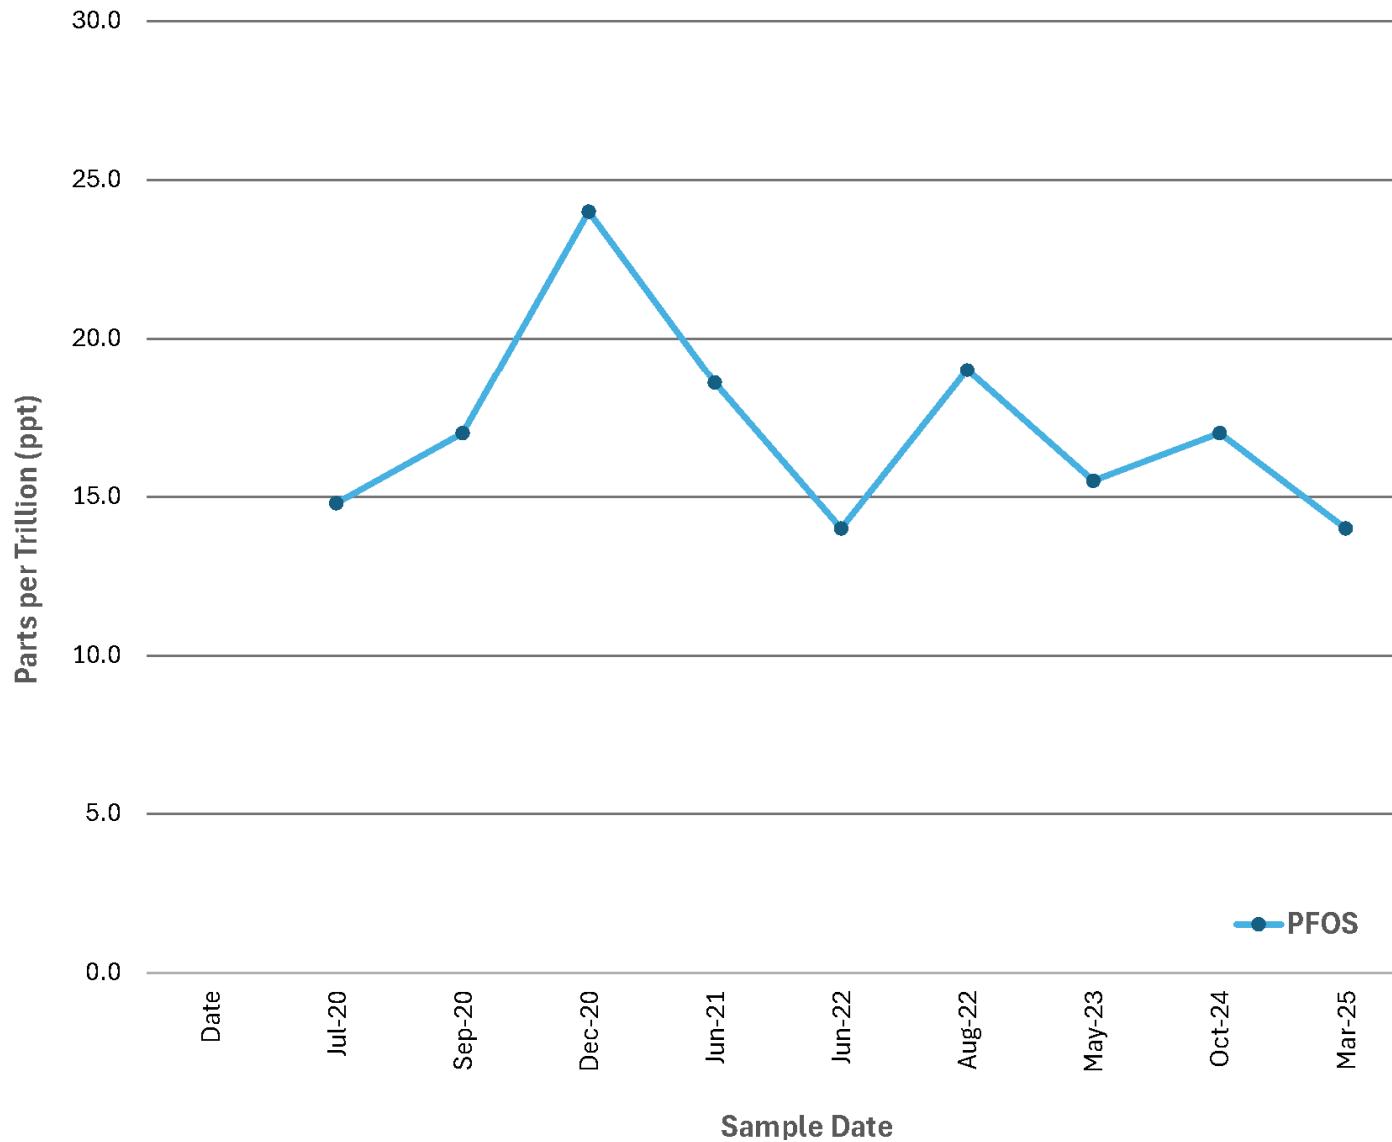

** Loveland is using a reporting limit of 4.0 ppt to be consistent with the Ohio EPA PFAS Action Plan.

Last Updated 4/4/2025